



PERMIT TO CONSTRUCT
Onsite Wastewater System

Permit ID: OSWW008142 v1.0
County: Darlington

Name: Tyler Sgro
Type Facility: Residential
Subdivision:
Block: Lot:

Site: Blanding Dr,
Hartsville, SC

Program Code: ALTERNATIVE
System Code: 232 INFILT QUICK4 PLUS
TM #: 057-13-01-001
Water Supply: Municipal

PERMIT TO CONSTRUCT SYSTEM SPECIFICATIONS

Daily Flow (gpd): 480 **Tank Sizes (gal):** Septic Tank: 1000 Pump Chamber: Grease Trap:
LTAR (g/d/ft²): 0.5 **Trenches:** Length (ft): 320 Width (in): 36 Max. Depth (in): 19 Agg. Depth (in): 8
Min Pump Capacity: GPM at ft. of Head

SPECIAL INSTRUCTIONS/CONDITIONS

THIS PERMIT IS SITE SPECIFIC. ANY CHANGES TO THE SYSTEM MUST BE APPROVED BY DHEC. ALTERNATIVE TRENCH PRODUCTS APPROVED UNDER STATE RULES AND REGULATIONS MAY BE SUBSTITUTED. ANY UNAPPROVED CHANGES WILL VOID THIS PERMIT.

Installers must contact the local Environmental Affairs office by 10:00 AM the day prior to installation in order to schedule a time for the final inspection. If a Department representative does not arrive within 30 minutes of the scheduled time, the installer may conduct the final inspection. When a contractor self-inspection occurs, the installer must complete DHEC form 3978, Approval to Operate Contractor Self-Inspection. The installer must submit the DHEC form 3978 within 2 business days of the completion of installation.

Self-installations require a pre-construction conference with a Department representative.

- Do not cut, fill, bulldoze, scrape or change the grade of the natural soils in the septic system area.
- All applicable setbacks set forth in Regulation 61-56 apply.
- No parking, driving, building or paving over the area of septic system before or after installation.
- Do not install under wet soil conditions. Minimum 9" cover over system after installation.
- **At the request of the applicant, the permit has been written specifically for the use of Infiltrator Low-Profile Quick 4 Chambers. No further reductions in linear length are allowed and the system must be installed by a licensed septic contractor.**
- **Permit issued based on soil work and system recommendations from Tyler Sgro, PSC #119.**

PERMIT TO CONSTRUCT SYSTEM DIAGRAM

See System Diagram on page 2 of this document.

Issued/Revised By:

Tee Thompson

Date: July 18, 2023




PERMIT TO CONSTRUCT

Onsite Wastewater System

Applicant: Tyler Sgro
Permit ID: OSWW008142 v1.0
County: Darlington

PERMIT TO CONSTRUCT SYSTEM DIAGRAM

23-1031 Palmetto Property Buyers - Blanding Dr

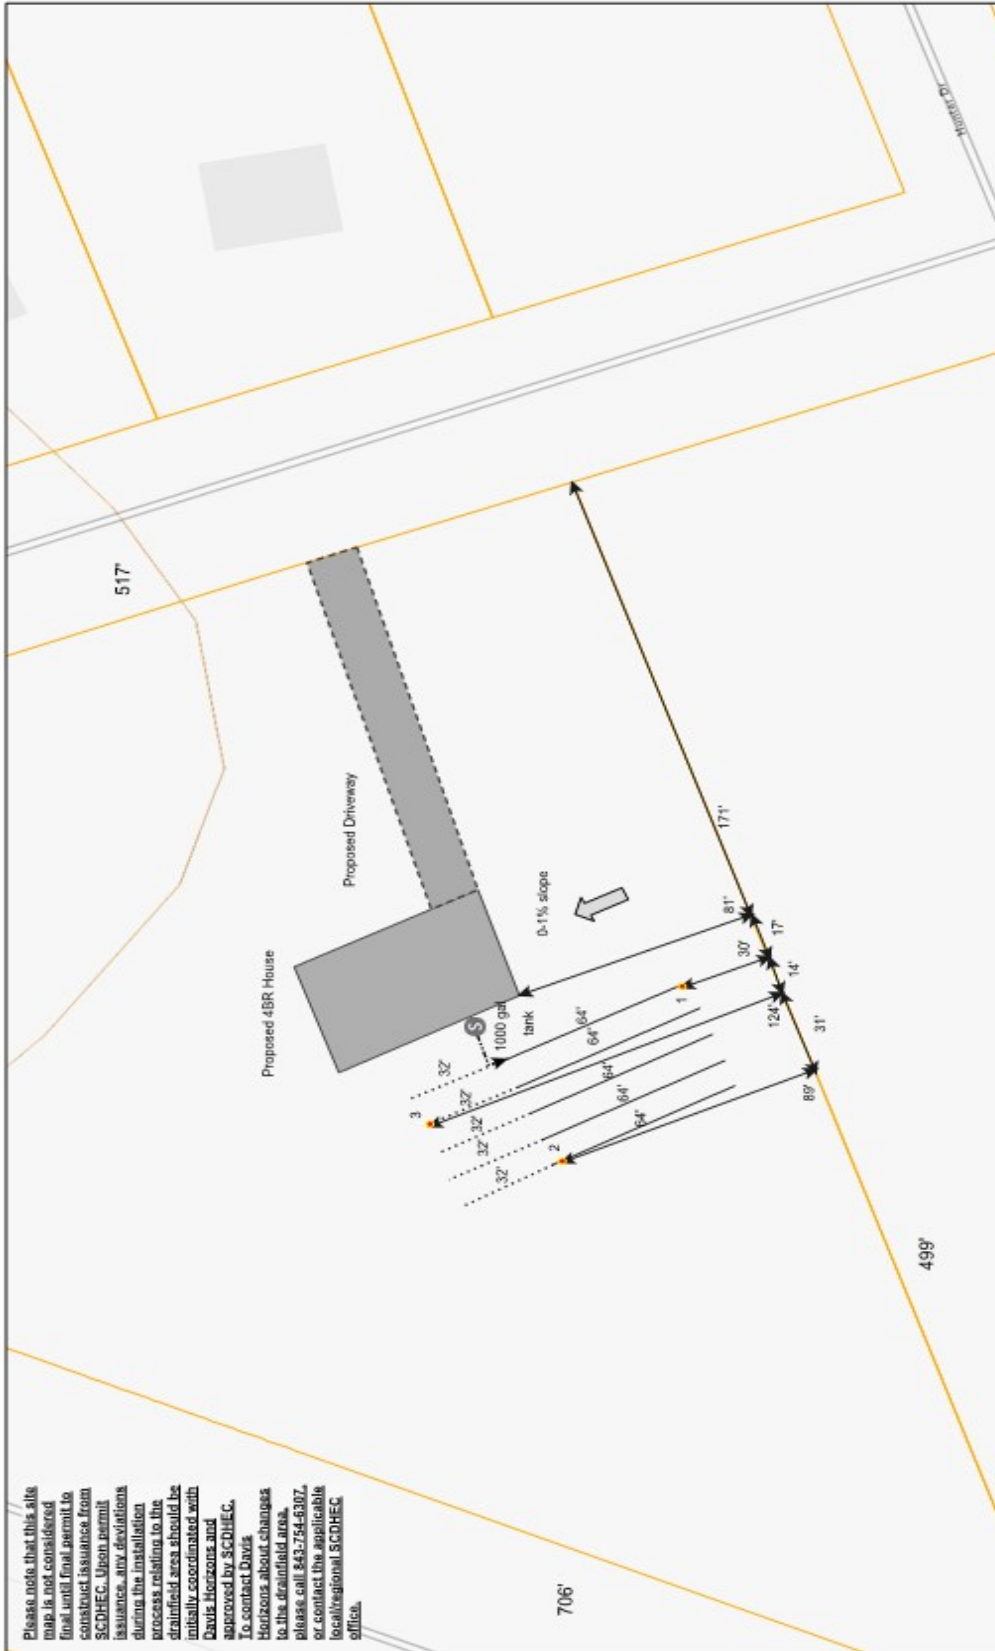

Please note that this site map is not considered final until final permit to construct issuance from SCDHEC. Upon permit issuance, any deviations during the installation process relating to the drainfield area should be initially coordinated with Davis Horizons and approved by SCDHEC. To contact Davis Horizons about changes to the drainfield area, please call 843.754.6302, or contact the applicable local/national SCDHEC office.

5/24/2023, 5:50:21 PM

- Soil Data Form
- Septic Design_804
- Distribution Line
- Parcels
- Septic Design_8153
- Distance/Setback
- Septic Design_9782
- House
- Driveway
- Septic Tank
- Drain Lines
- Repair Lines
- Normal Intermediate Contours
- Normal Index Contours

1:564

0 5 10 20 m

0 30 60 120 ft

Esri, Community Maps Contributors, OpenStreetMap, Microsoft, Esri, HERE, Garmin, Swiremap, Geotitles, Inc, METNUSA, USGS, EPA, NPS, US Census Bureau, UBDA, USGS The National Map, 3D

This map is created by Davis Horizons. Unauthorized use of this map without explicit written permission from Davis Horizons is prohibited.

Created By: Davis Horizons